



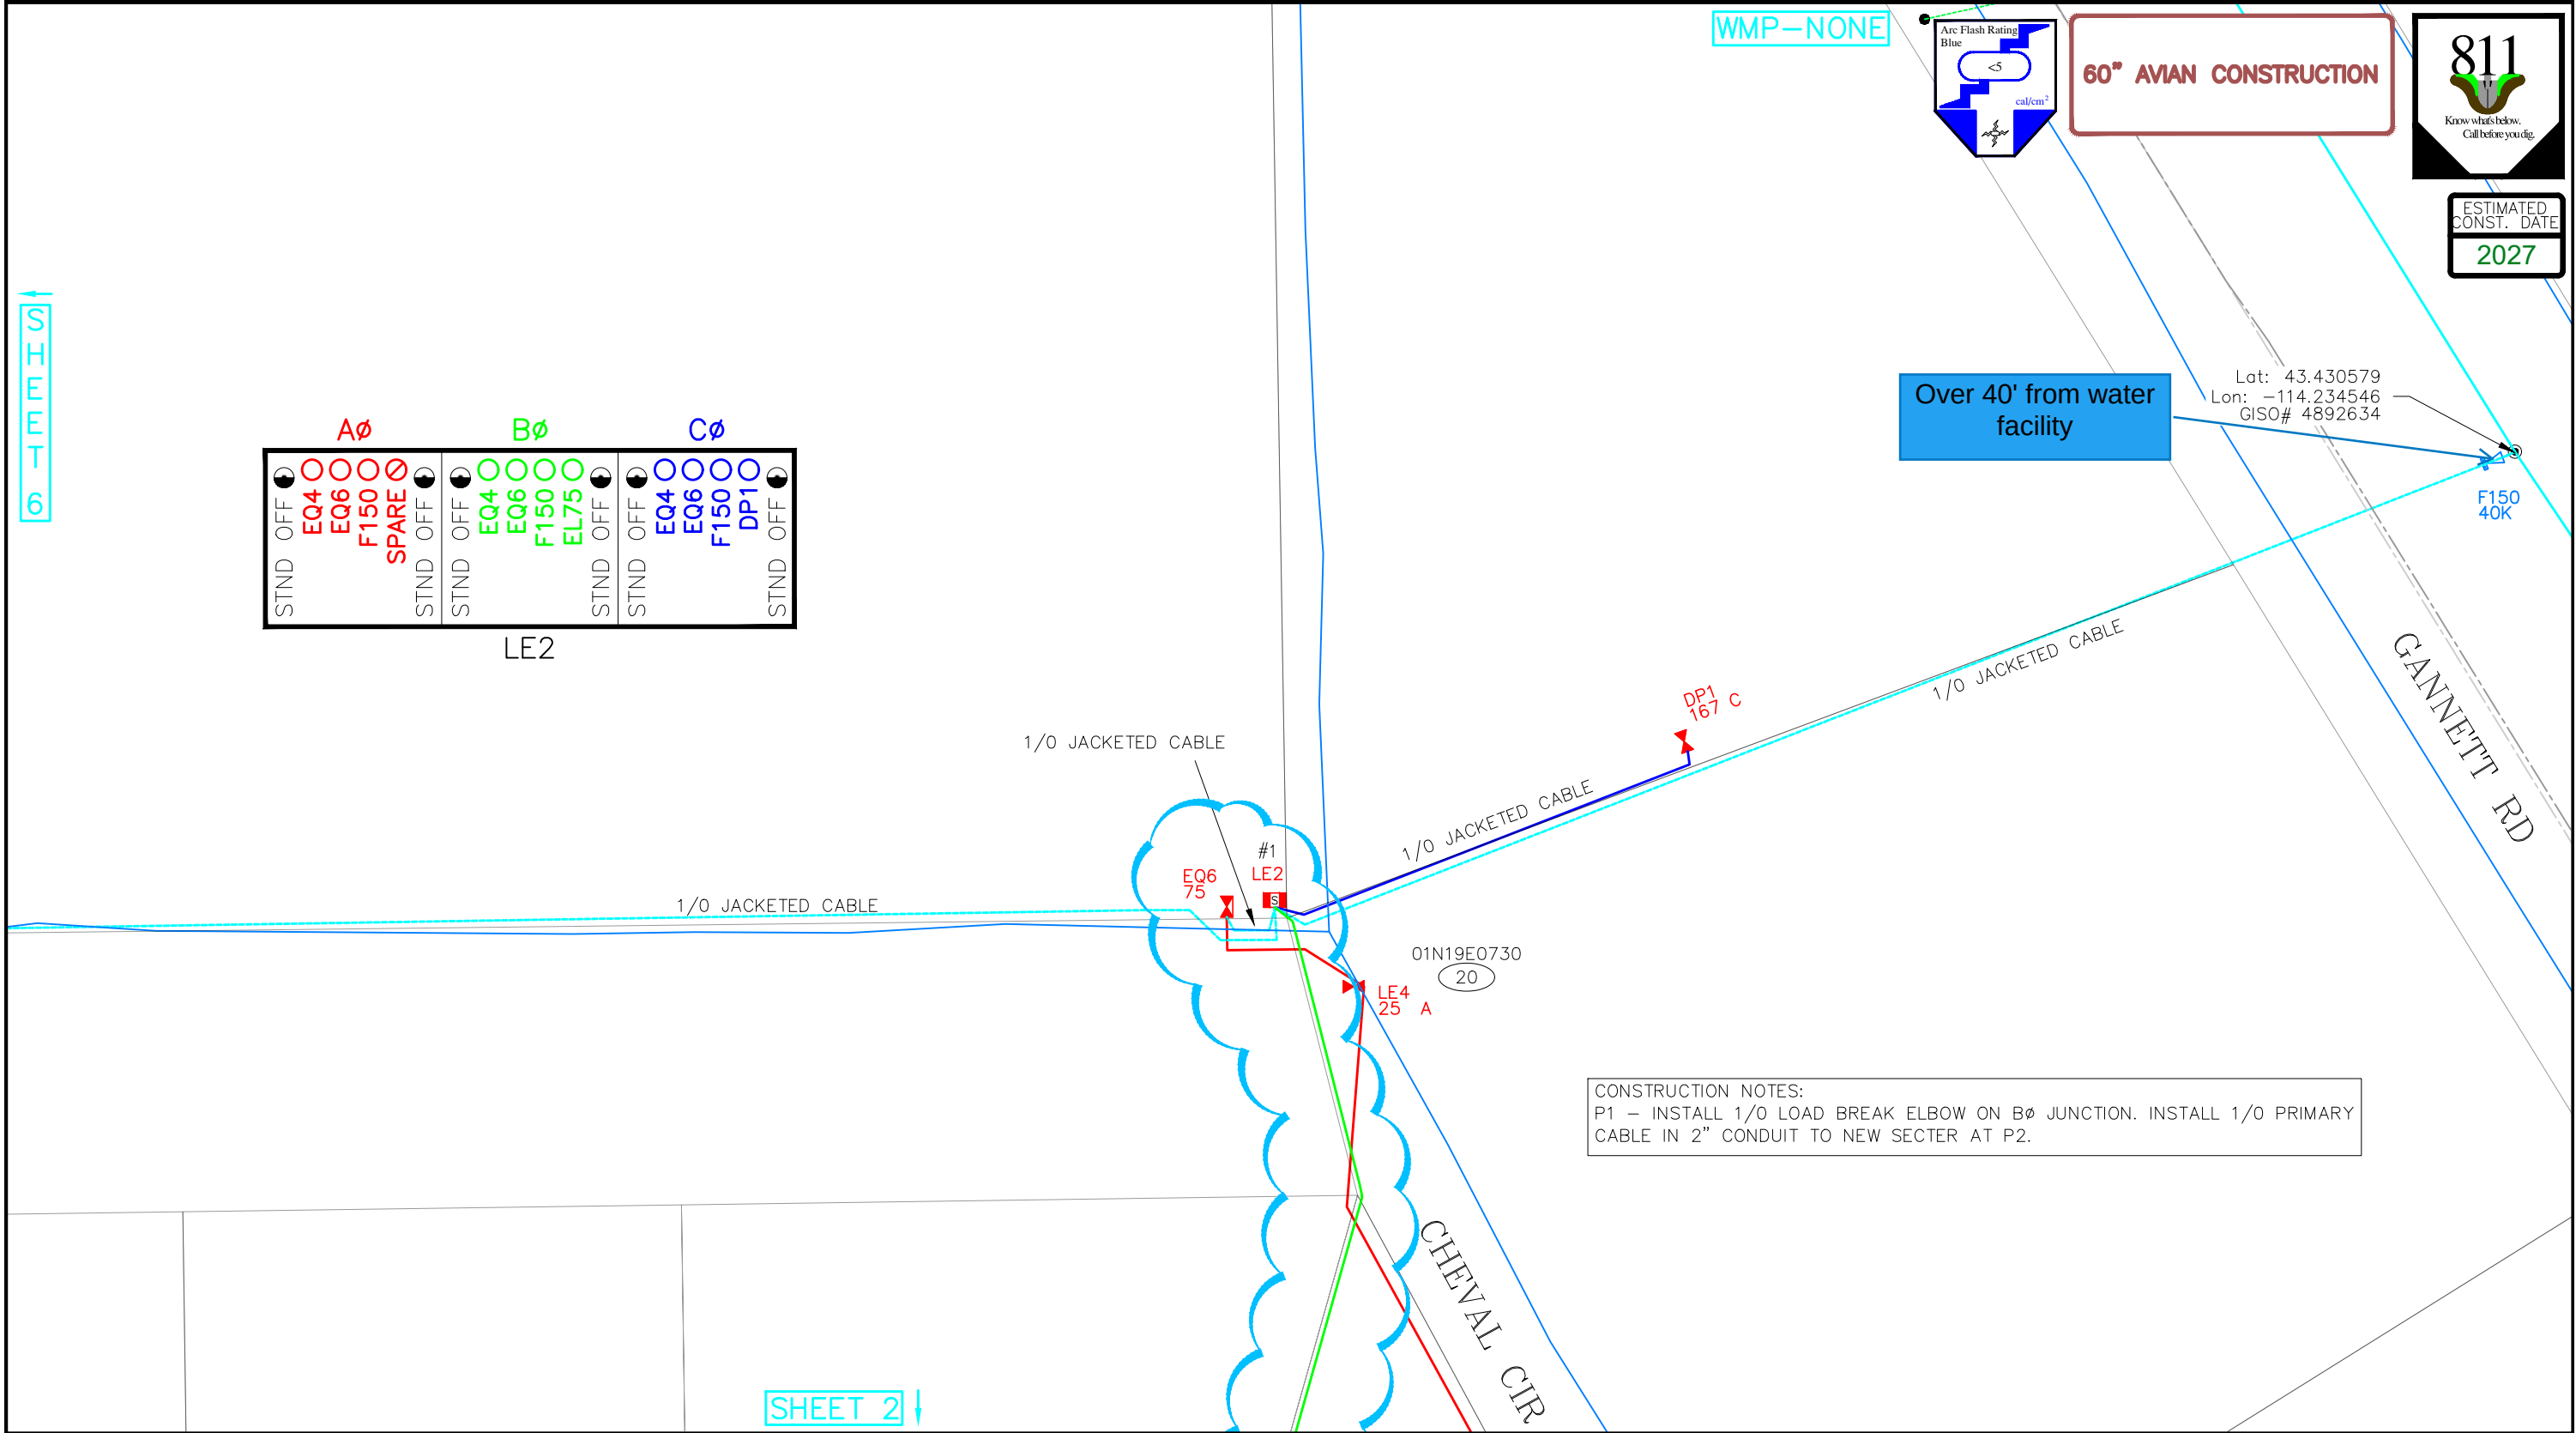

Job Title: UGCR HALY11 F150 CABLE REPLACEMENT		Feeder Map File Name: HALY1101		Surveyed or GPS: NONE Joint Use Attachment: NO		FDR By: ---- Date: ---- ArcFM By: ---- Date: ----		Designer: CAE2362 Design No: 0000179042 Work Order No: 27685438		
Additional Description: ----		Qua 1	Twn 01N	Rng 19E	Sec 07	BM BLAINE	Construction Date: ---- Operating Voltage: 12.5kV		Scale: 1" = 100	
Additional Description: ----		State ID		County BLAINE		Operating Voltage: 12.5kV		Sheet <u>1</u> of <u>8</u>		

CONSTRUCTION NOTES:
ABANDON DIRECT BURIED CABLE
P2 - INSTALL NEW SECTER WITH 1/0 LOAD BREAK ELBOWS AND 1/0 PRIMARY CABLE IN 2" CONDUIT.
P3 - REMOVE ELBOWS AND ABANDON DIRECT BURIED PRIMARY CABLE. INSTALL 1/0 LOAD BREAK ELBOWS AND 1/0 PRIMARY CABLE IN 2" CONDUIT.
P4 - REMOVE ELBOWS AND ABANDON DIRECT BURIED PRIMARY CABLE. INSTALL 1/0 LOAD BREAK ELBOWS AND 1/0 PRIMARY CABLE IN 2" CONDUIT.
P5 - REMOVE ELBOWS AND ABANDON DIRECT BURIED PRIMARY CABLE. INSTALL 1/0 LOAD BREAK ELBOWS AND 1/0 PRIMARY CABLE IN 2" CONDUIT.


JESS: RADIAL FEED EL10 FROM EL70??

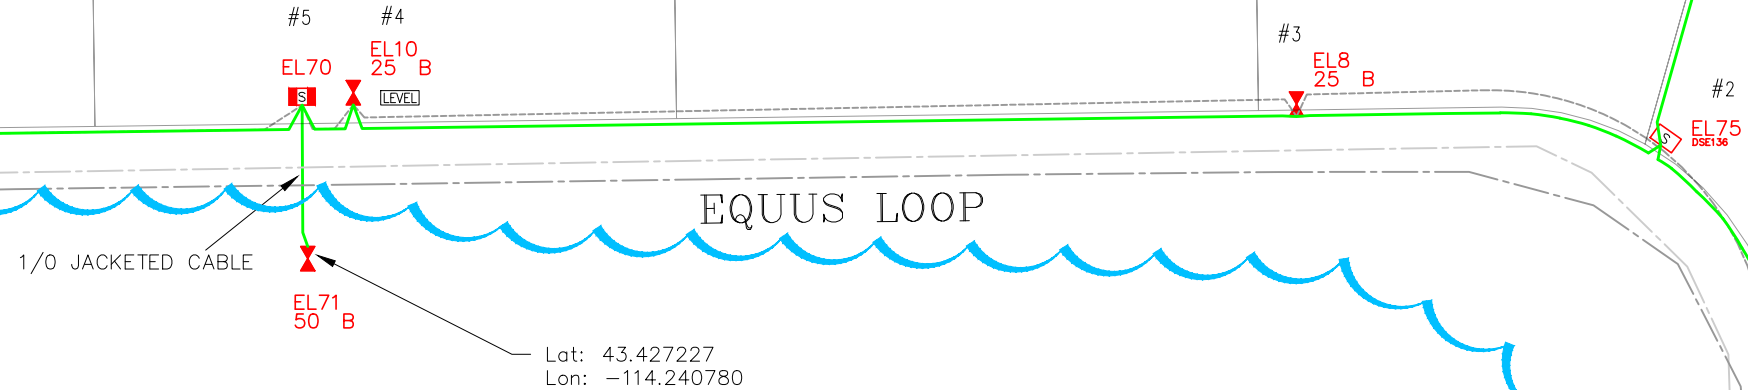


60" AVIAN CONSTRUCTION



Since there is another crossing we will need to reach out on it might make sense to see if this is truly where this water is. Wood River Valley Irr. District NO45



Job Title: UGCR HALY11 F150 CABLE REPLACEMENT		Feeder Map File Name: HALY1101		Surveyed or GPS: NONE		FDR By: ----		Designer: CAE2362	
Additional Description: ----		Qua 1		Twn 01N		Rng 19E		Date: ----	
Additional Description: ----		Sec 07		County BLAINE		Built as Designed: ----		Design No: 0000179042	
		State ID		Operating Voltage: 12.5kV		ArcFM By: ----		Work Order No: 27685438	
IDaho POWER Co. WORK ORDER MAP						SCALE: 1" = 100		Sheet <u>2</u> Of <u>8</u>	

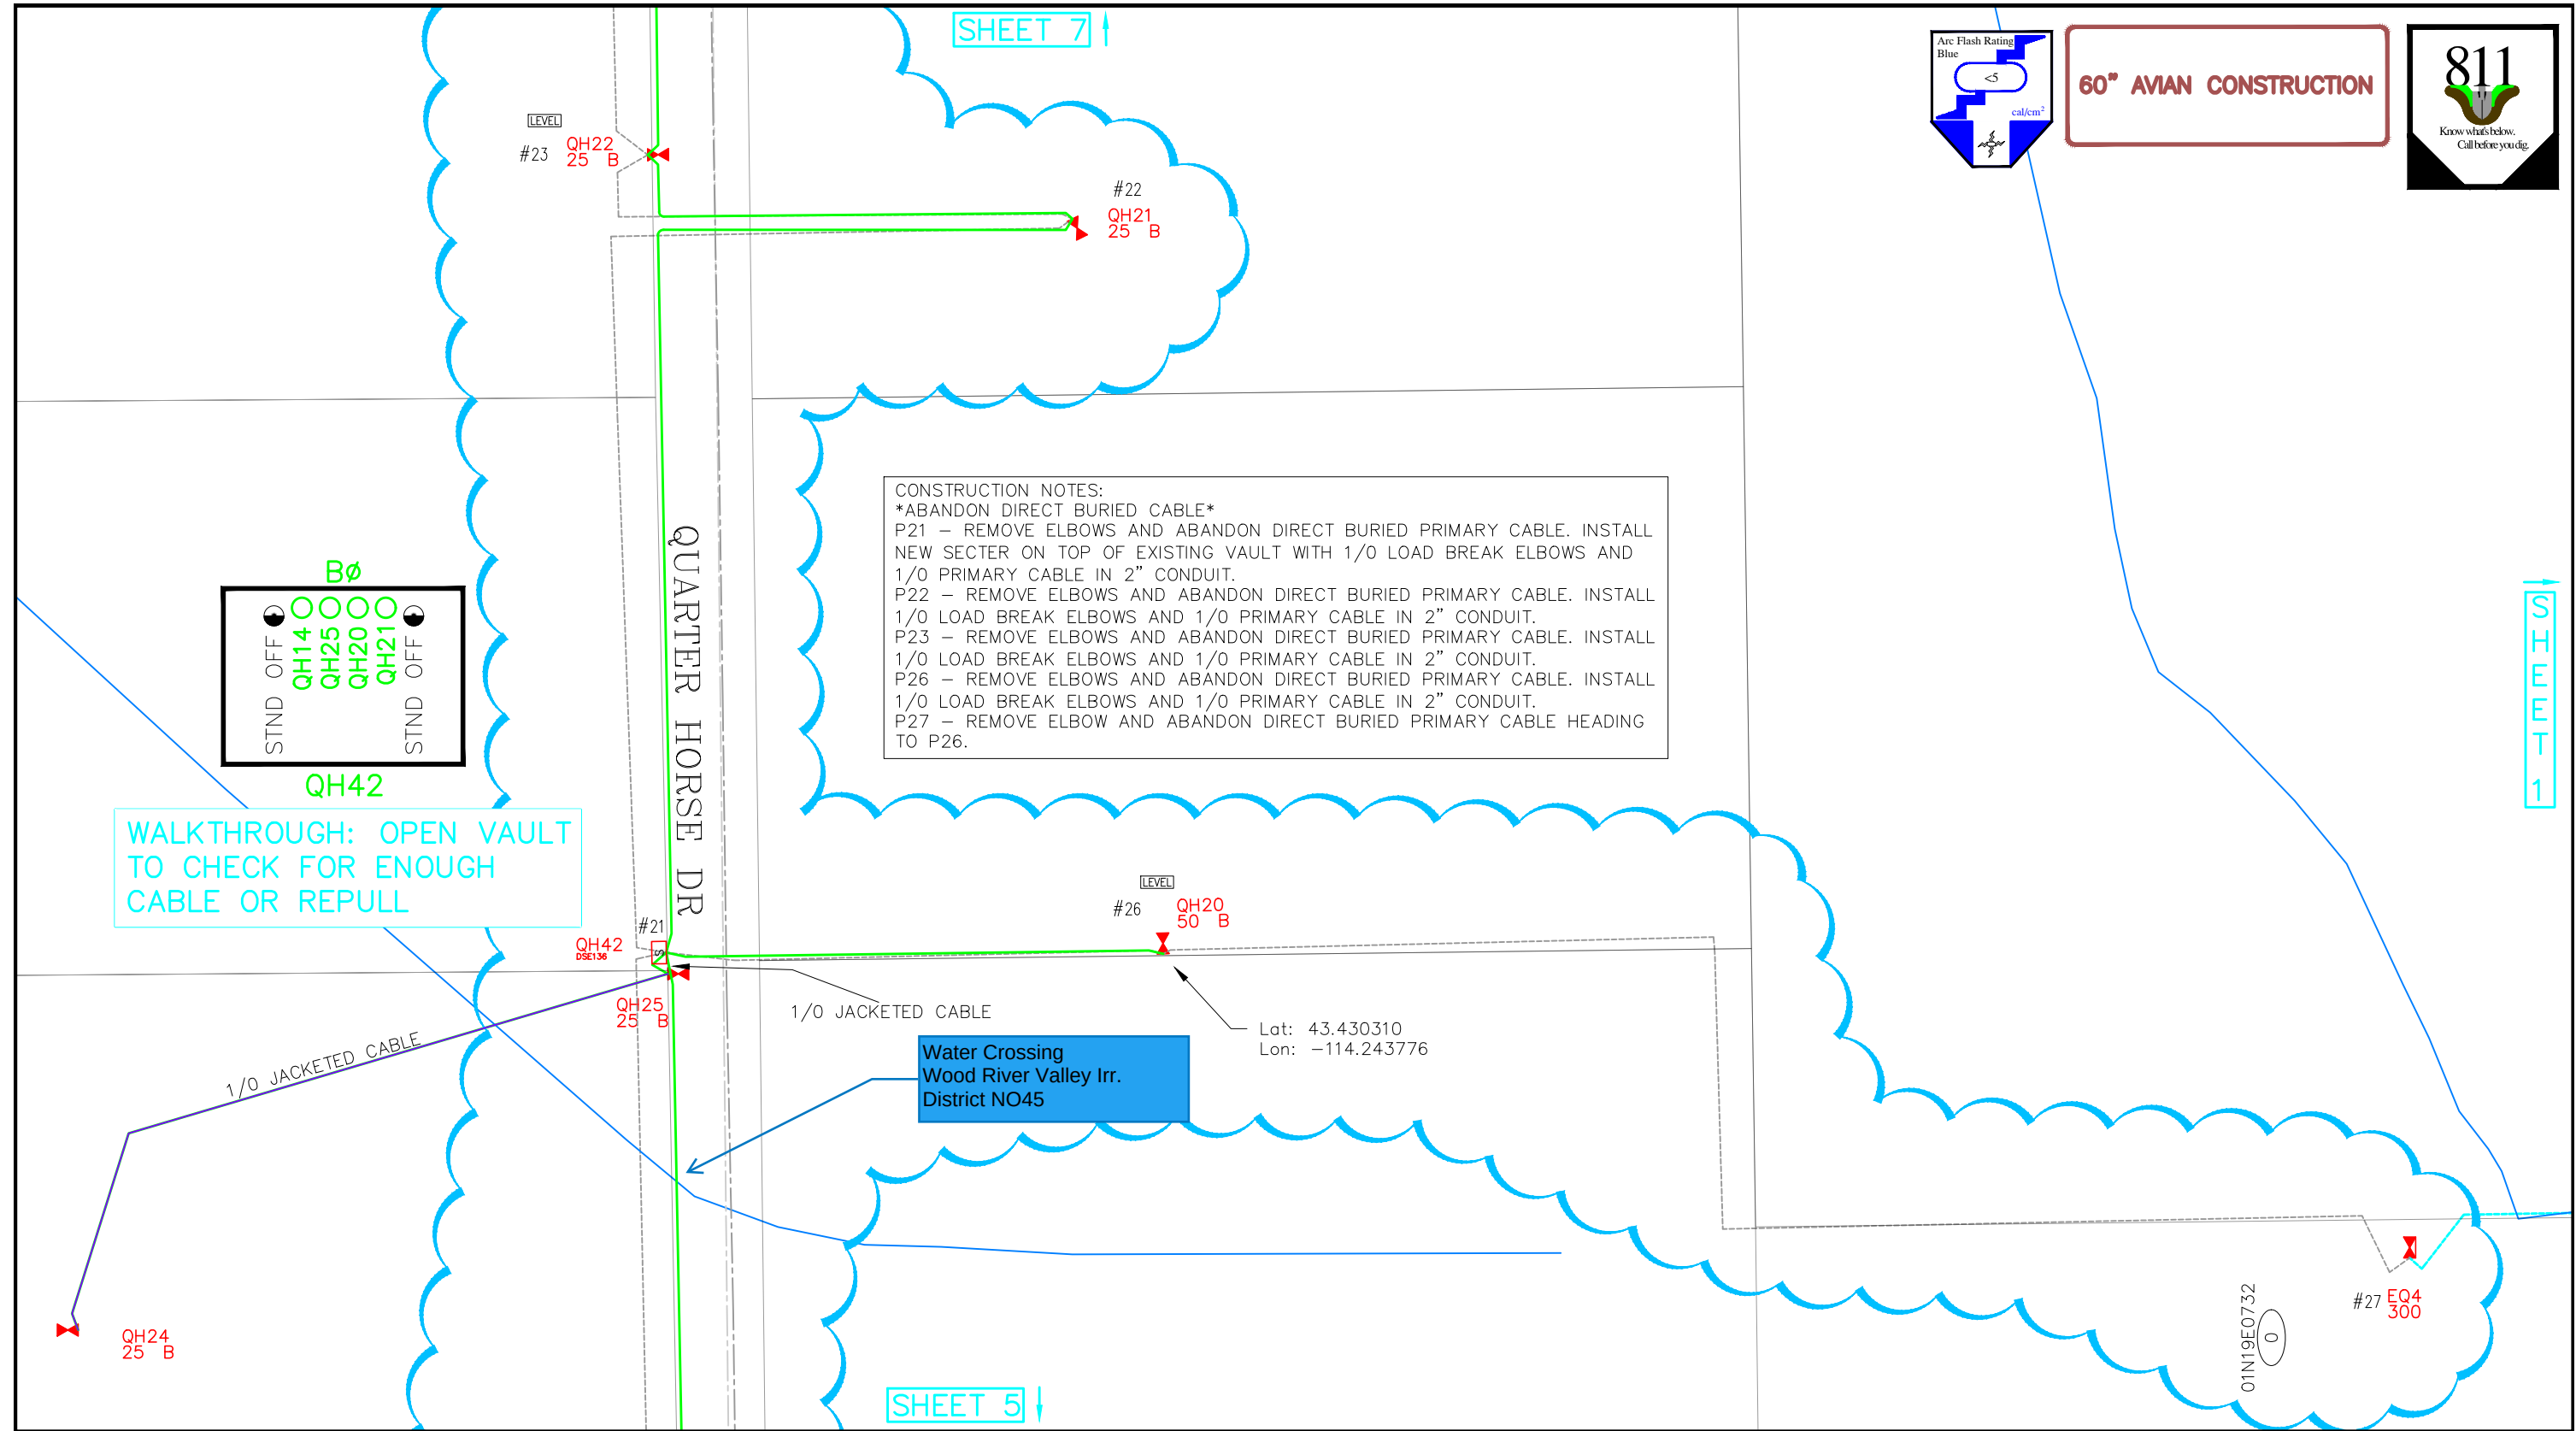

Job Title: UGCR HALY11 F150 CABLE REPLACEMENT		SWPP:-----		TIMES SCALE 0 1 2 3 4		Customer:		Date:							
Additional Description: -----		Feeder Map File Name: HALY1101		Surveyed or GPS: NONE Joint Use Attachment: NO				FDR By: -----		Designer: CAE2362					
Additional Description: -----		Qua 1 TwN 01N Rng 19E Sec 07 BM		Pre-Built Date: -----				Date: -----		Design No: 0000179042					
		State ID		County BLAINE				Built as Designed: -----		Work Order No: 27685438					
				Operating Voltage: 12.5kV				ArcFM By: -----		Date: -----					
IDAHO POWER Co. WORK ORDER MAP												SCALE: 1" = 100		Sheet <u>6</u> Of <u>8</u>	